
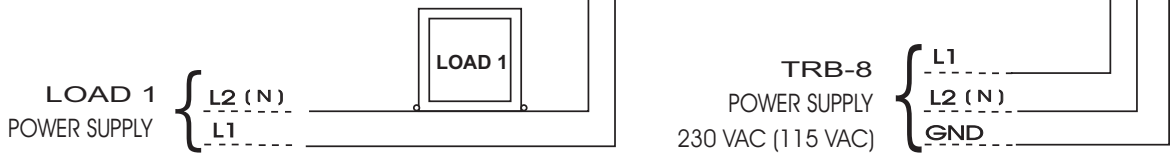
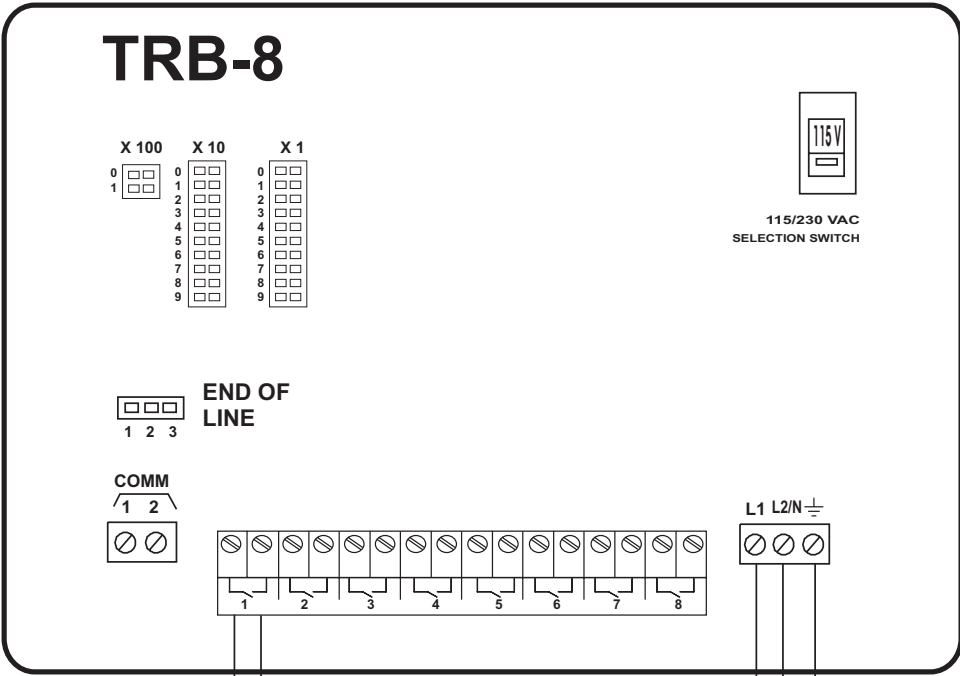


LEAVE A CLEARANCE OF AT LEAST 12" TO THE LEFT OF THE CONTROLLER BOX TO ALLOW FOR THE COVER TO BE REMOVED FOR MAINTENANCE.



DO NOT DRILL THE SIDES OF THE UNIT CONTROL. USE AVAILABLE KNOCK OUTS AT THE BOTTOM OF THE UNIT.



MAXIMUM LOAD RATINGS :
 MAX MOTOR LOAD = 1/2HP AT 250 VAC
 MAX RESISTIVE LOAD CURRENT = 10A.

Switch relay coil in power unit if the motor load exceeds 1/2HP



PN895-00399 Rev.00

WIRING DIAGRAM	
TRB-8	
#891-00186	Rev.01